



County of San Diego
Planning & Development Services
BUILDING DIVISION

ACCESSIBILITY CORRECTION LIST

Multifamily Housing

12A

Public Telephones

PLAN CHECK #:

OWNER ON APPLICATION:

SCOPING

- Public telephones provided in common-use spaces shall be accessible per the following:
 - On floors where public telephones are provided, at least one accessible telephone required
 - On floors where two or more banks of multiple telephones provided, at least one accessible telephone required in each bank

CBC 1140A.1

VOLUME-CONTROL TELEPHONES

- Where public telephones are provided in common-use areas, identify at least one telephone equipped with volume control on each floor or in each bank, whichever is more.

CBC 1140A.6

- Specify volume-control telephones complying with the following:
 - Receiver generating magnetic field in area of receiver cap
 - Hearing-aid compatible
 - Minimum 12 decibels and maximum 18 decibels above normal

Exception: 18 decibels may be exceeded if an automatic reset is provided

 - Identified by signage per CBC Figure 11A-11D

CBC 1140A.6

TEXT TELEPHONES

- If a total of four or more public telephones are provided at the interior and exterior of a site – with at least one at an interior location – specify at least one interior phone as a text telephone and identified by signage per CBC Figure 11A-11C.

CBC 1140A.7

DIMENSIONS AND CLEARANCES

- Dimension wheelchair clear floor/ground space complying with the following at each accessible telephone:

- Minimum 30 inches by 48 inches per CBC Figure 11A-11B

Exception: At accessible telephones located within alcoves, dimension clear floor/ground space per CBC Figure 11A-1H(b)
- Allowing forward or parallel approach
- One full unobstructed side adjoining another wheelchair clear floor/ground space

CBC 1140A.2 and CBC 1140A.3

- Dimension mounting height of each accessible telephone with highest operable part complying with the following:

- Where only forward approach allowed, per CBC Figure 11A-11B(c)
- Where parallel approach allowed, per CBC Figure 11A-11B(a)
- Where telephone mounted in corner requiring wheelchair users to reach diagonally, per CBC Figure 11A-11B(b)

CBC 1140A.4

- Dimension any telephone enclosures per the following:

- Where only forward approach allowed, per CBC Figure 11A-11B(c)
- Where parallel approach allowed, per CBC Figure 11A-11B(a)
- Where full-height enclosure proposed, per CBC Figure 11A-11B(b)

CBC 1140A.5

- Specify minimum 29-inch-long cord from phone to handset.


CBC 1140A.9

- Where telephone books provided, dimension mounting height within reach ranges per accessibility correction list 5A.


1140A.10

- Specify push-button telephone controls where service available.

CBC 1140A.8

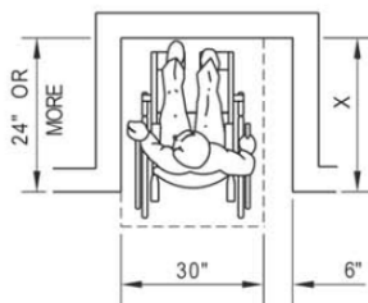

NOTE : IF X > 24 INCHES, THEN AN ADDITIONAL MANEUVERING CLEARANCE OF 6 INCHES SHALL BE PROVIDED AS SHOWN.

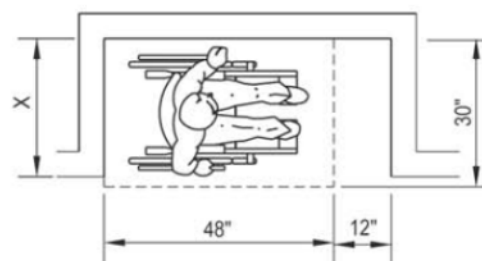


NOTE : IF X > 15 INCHES, THEN AN ADDITIONAL MANEUVERING CLEARANCE OF 12 INCHES SHALL BE PROVIDED AS SHOWN.

CBC FIGURE 11A-1H(b) – ALCOVE MANEUVERING SPACE

**THIS DOCUMENT IS FOR PLAN REVIEW ONLY.
CORRECTION LIST ITEMS MAY NOT BE REPRODUCED OR COPIED ON PLANS.
PROVIDE COMPLETE DETAILS, DIMENSIONS, AND NOTES TO SATISFY CORRECTION ITEMS.**

5510 OVERLAND AVE, SUITE 110, SAN DIEGO, CA 92123 • (858) 565-5920 • (888) 336-7553

[HTTP://WWW.SDCPS.ORG](http://www.sdcps.org)

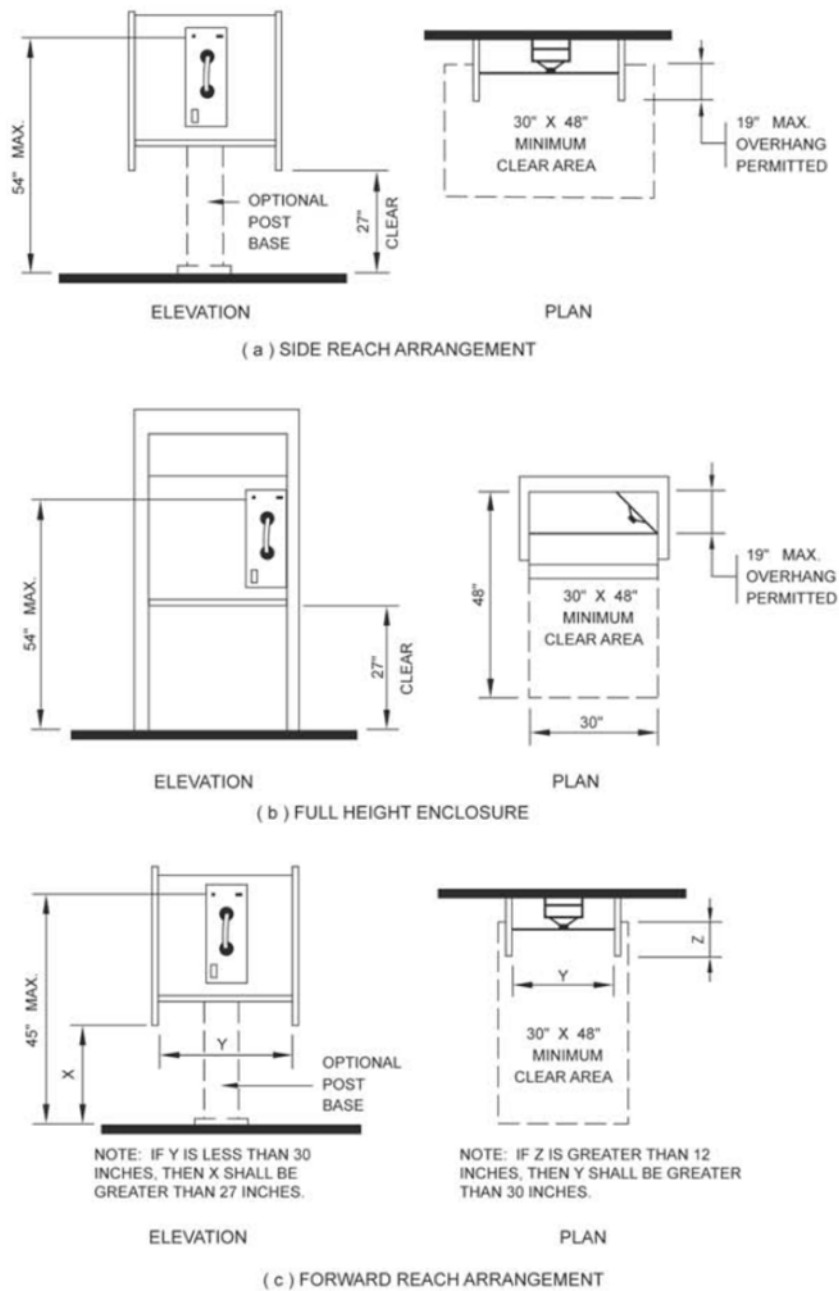

CBC FIGURE 11A-11B – TELEPHONE MOUNTING HEIGHTS AND CLEARANCES



CBC FIGURE 11A-11C – INTERNATIONAL TTY SYMBOL



CBC FIGURE 11A-11D – VOLUME-CONTROL TELEPHONES

**THESE FIGURES ARE FOR ILLUSTRATIVE PURPOSES ONLY.
THEY ARE NOT INTENDED FOR REPRODUCTION AS PLAN DETAILS.
IF CONFLICTS EXIST BETWEEN THESE FIGURES AND THE TEXT
OF THE *CALIFORNIA BUILDING CODE*, THE CODE TEXT SHALL GOVERN.**